



Argonne Scan anl0047Kv on 20011001 with CF ID = 14


Module Average

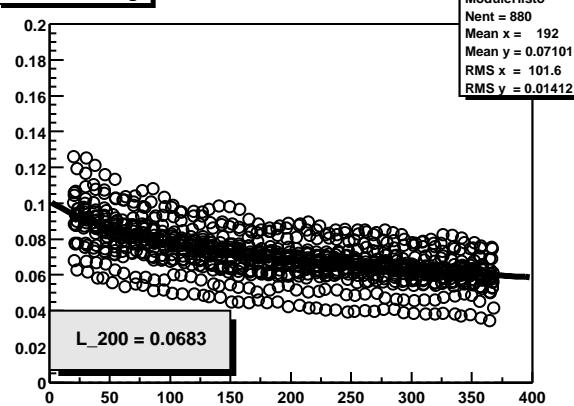


L200 per strip

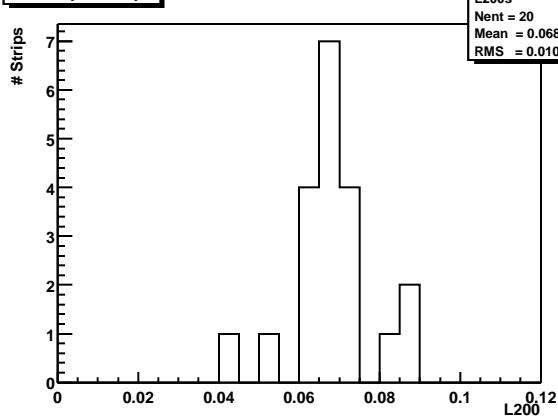


L200 vs Strip

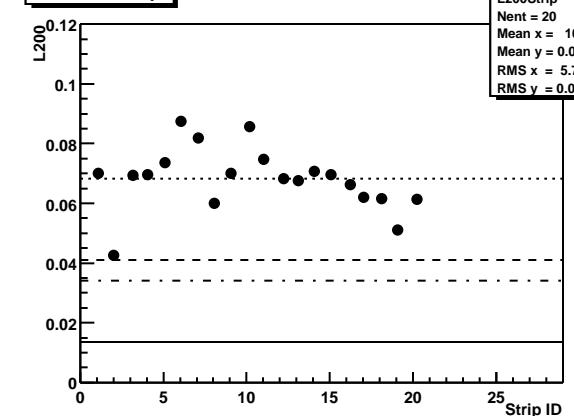


Fiber Average

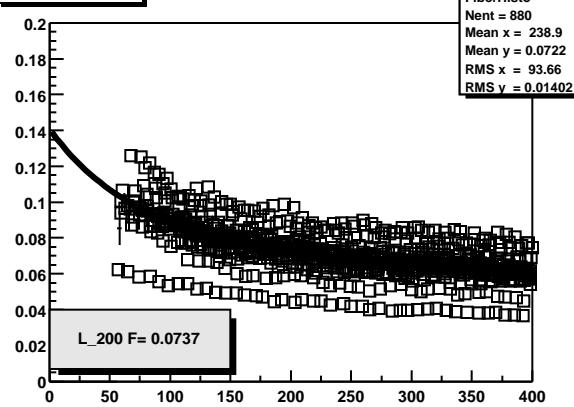


L200 Fiber per strip

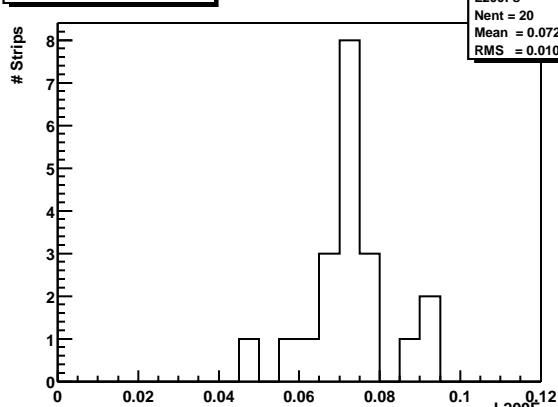


L200 Fiber vs Strip

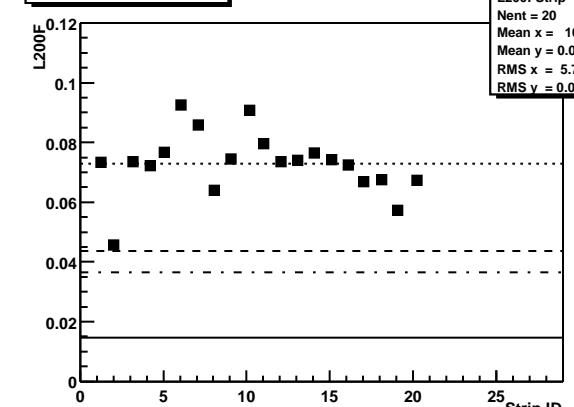


20 pc Deviants

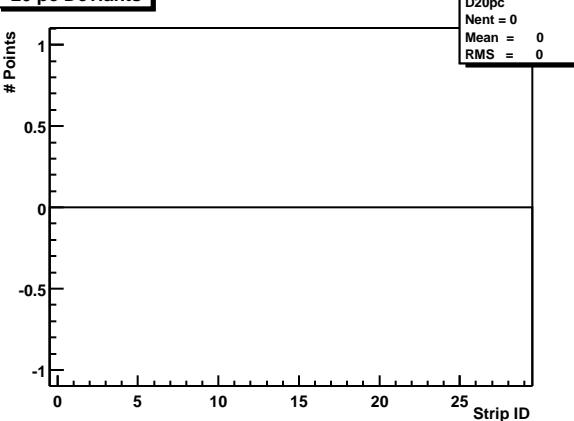

30 pc Deviants


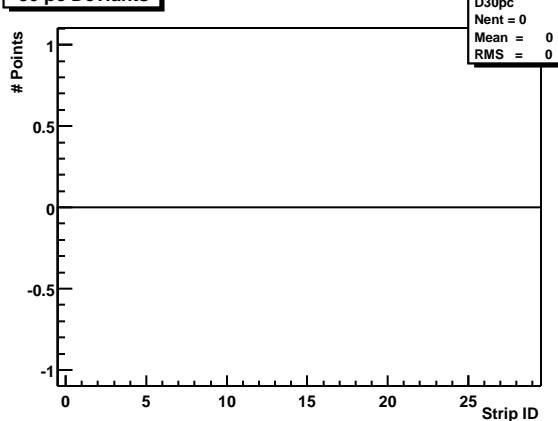


Ratios






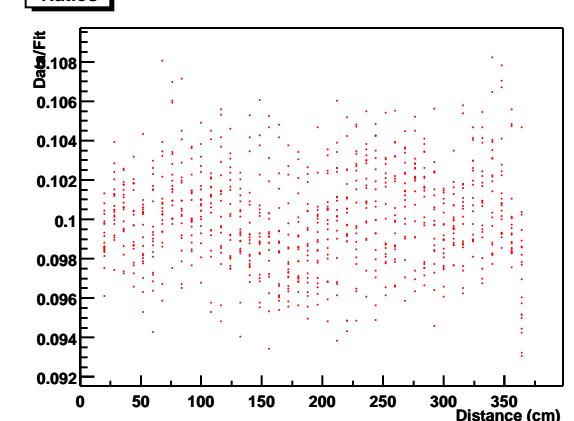


Fri Jul 26 11:48:54 2002







Argonne Scan anl0047Kv on 20011001 with CF ID = 14

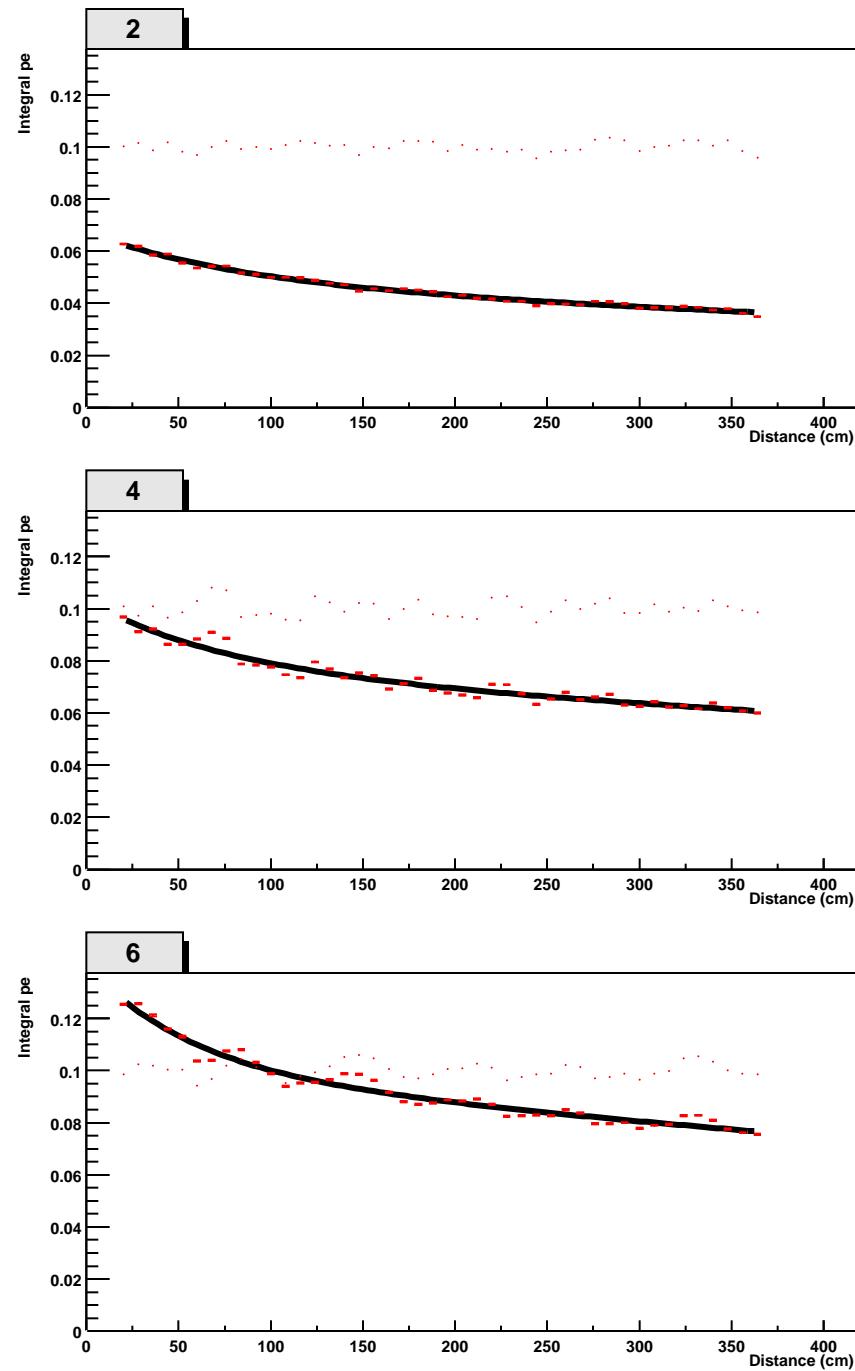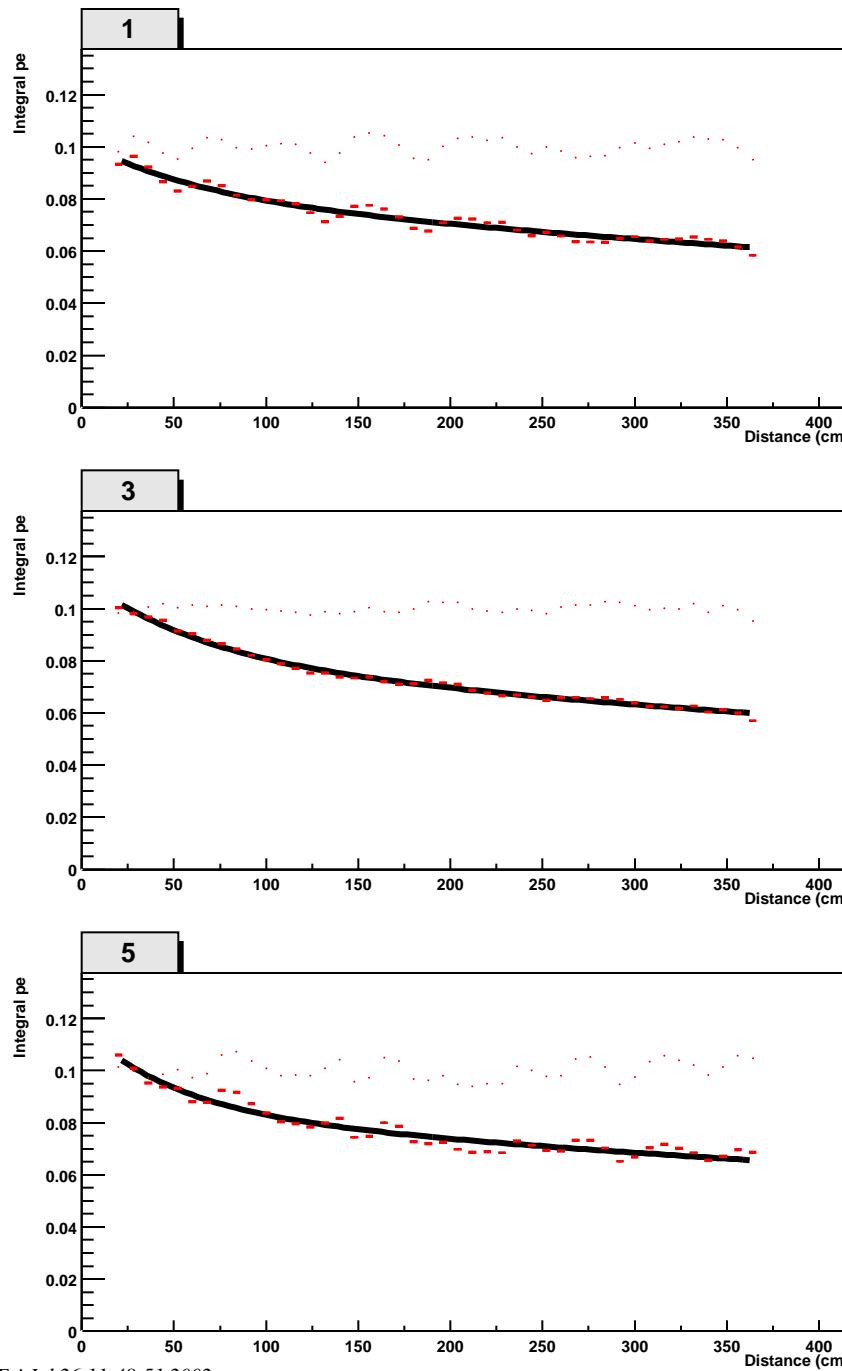





Argonne Scan anl0047Kv on 20011001 with CF ID = 14

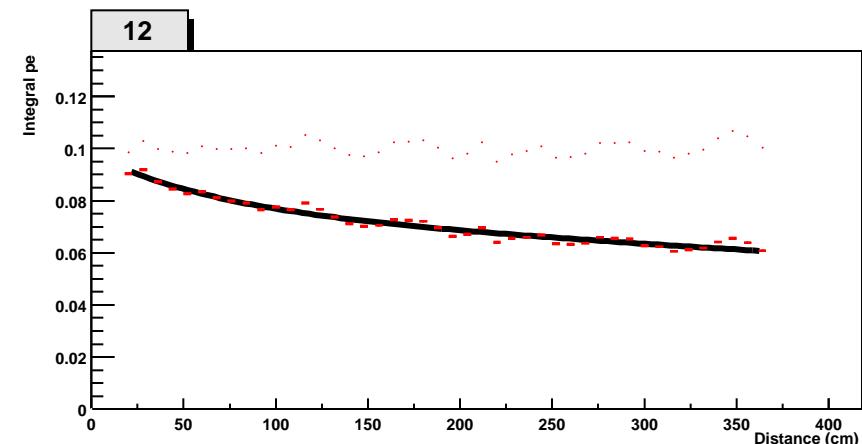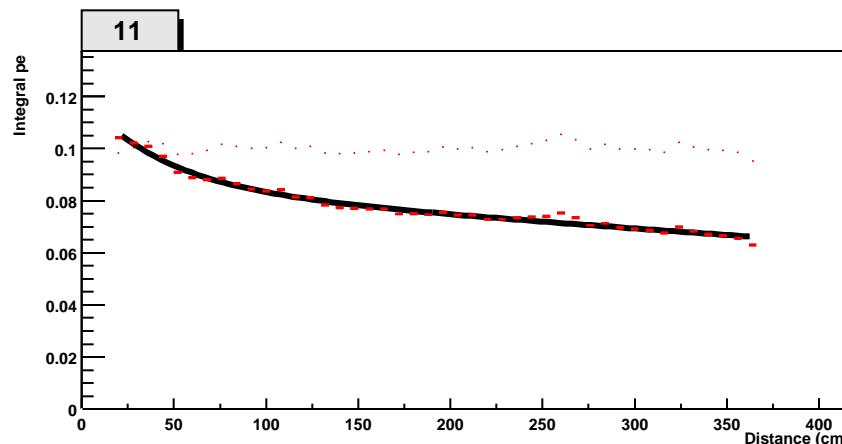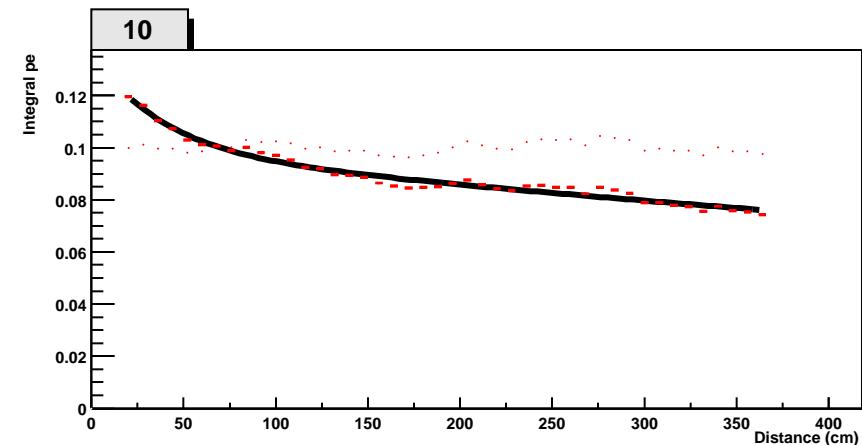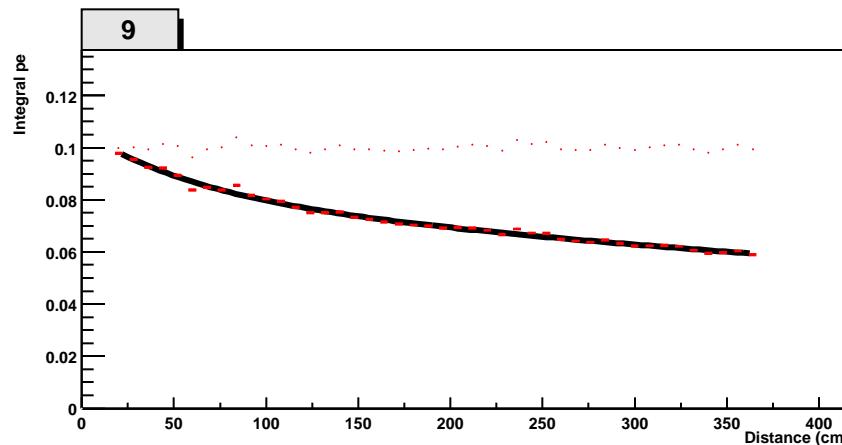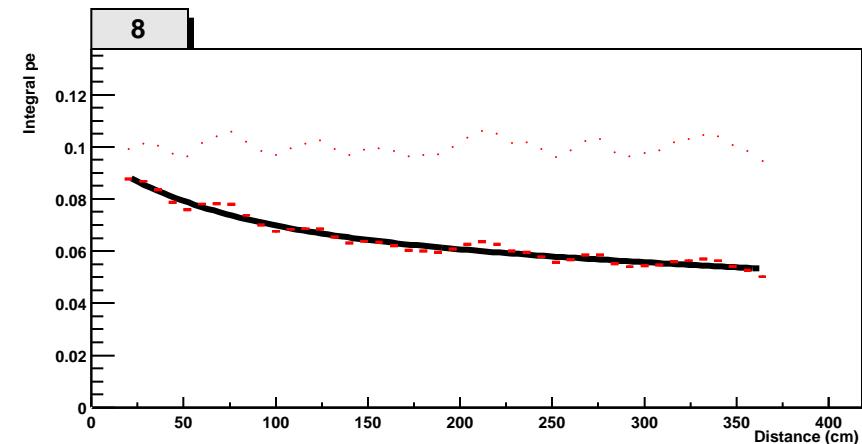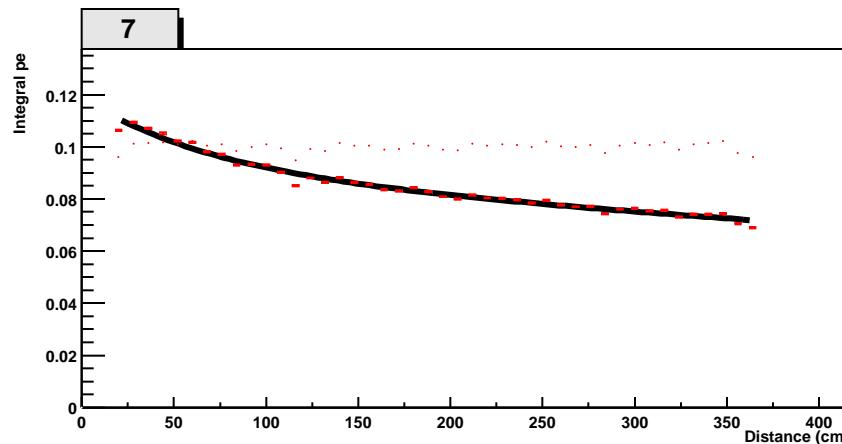

Argonne Scan anl0047Kv on 20011001 with CF ID = 14

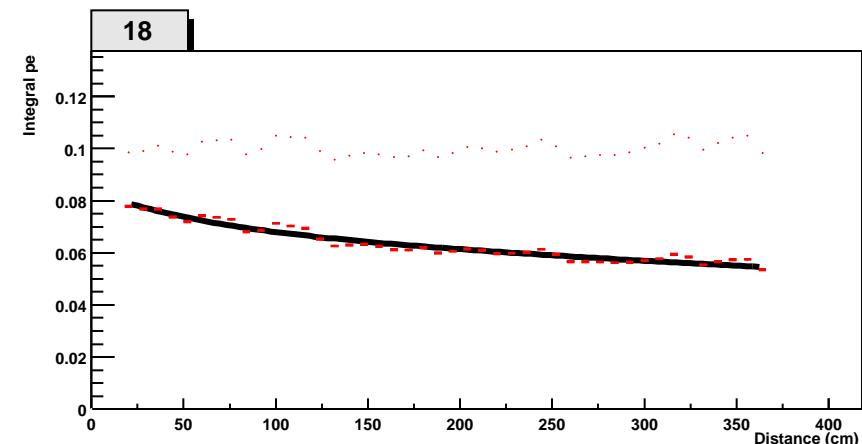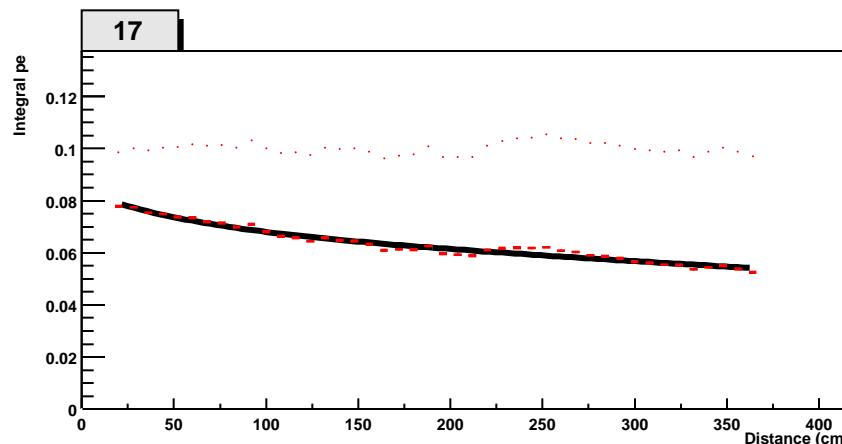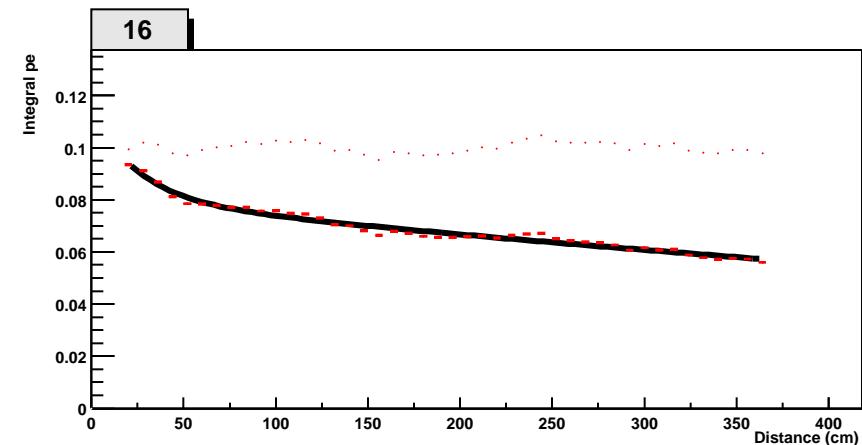
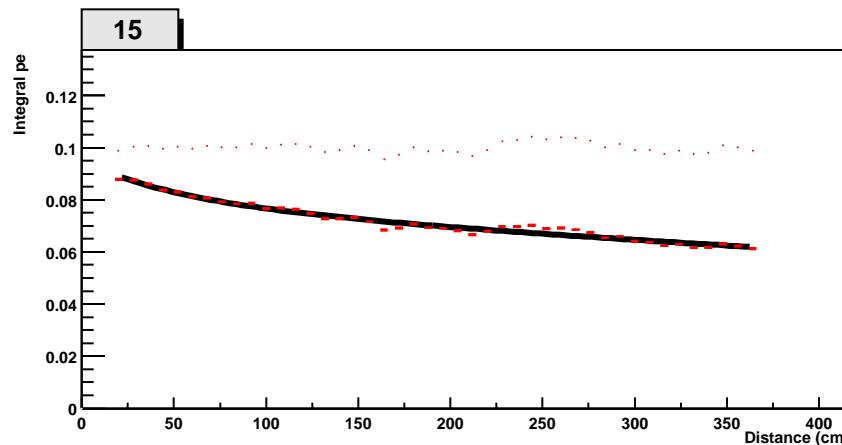
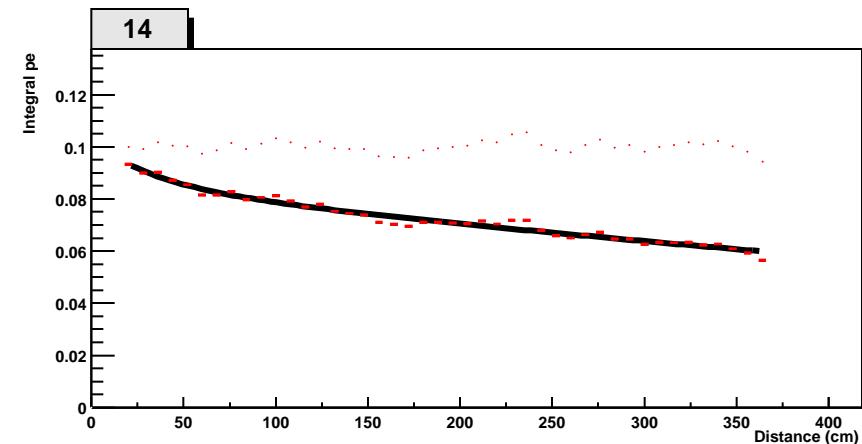
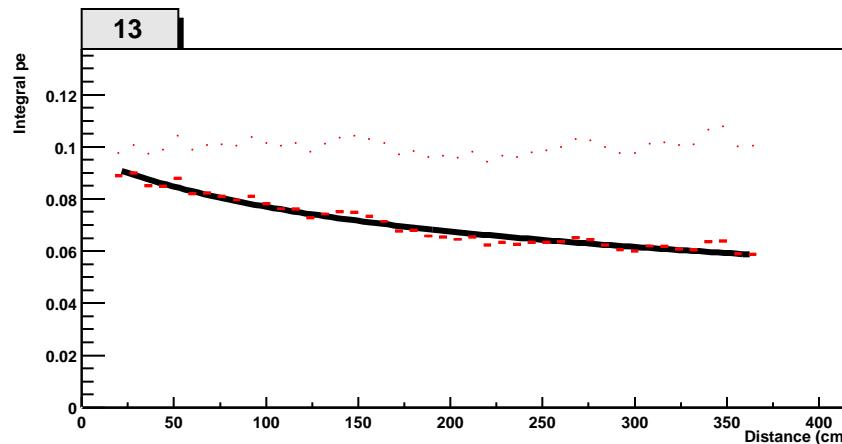


Argonne Scan anl0047Kv on 20011001 with CF ID = 14

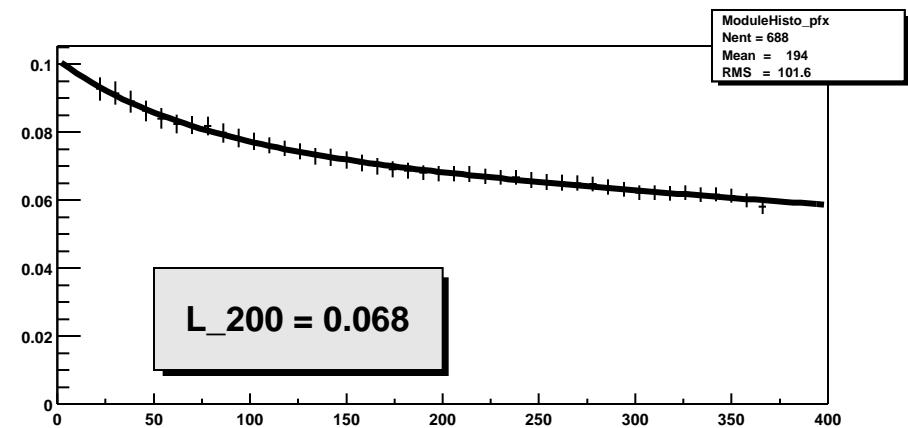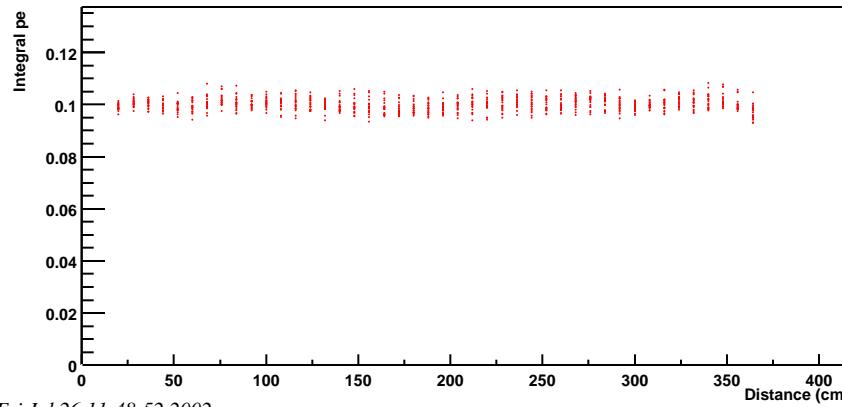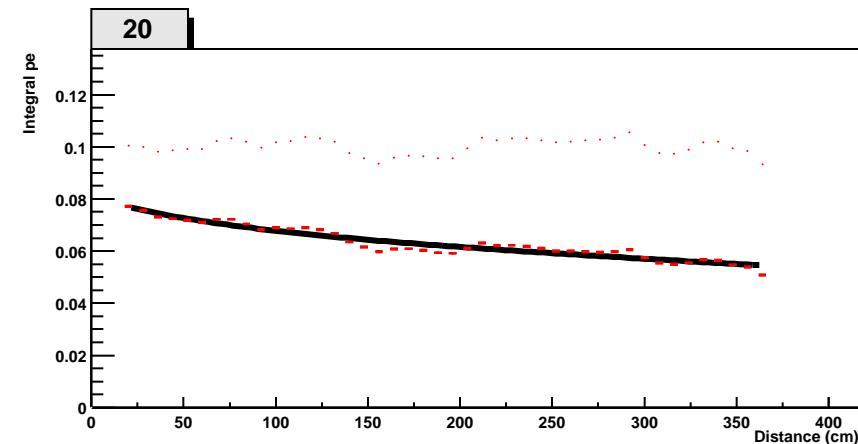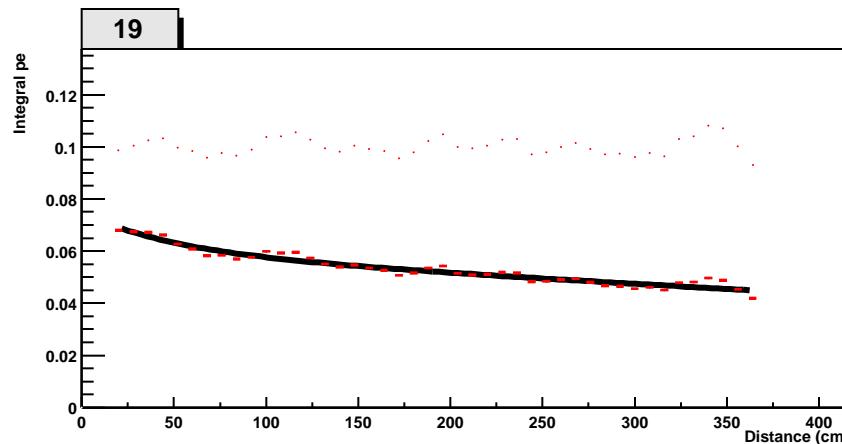

Fri Jul 26 11:48:52 2002

Argonne LI Scan for anl0047Kv

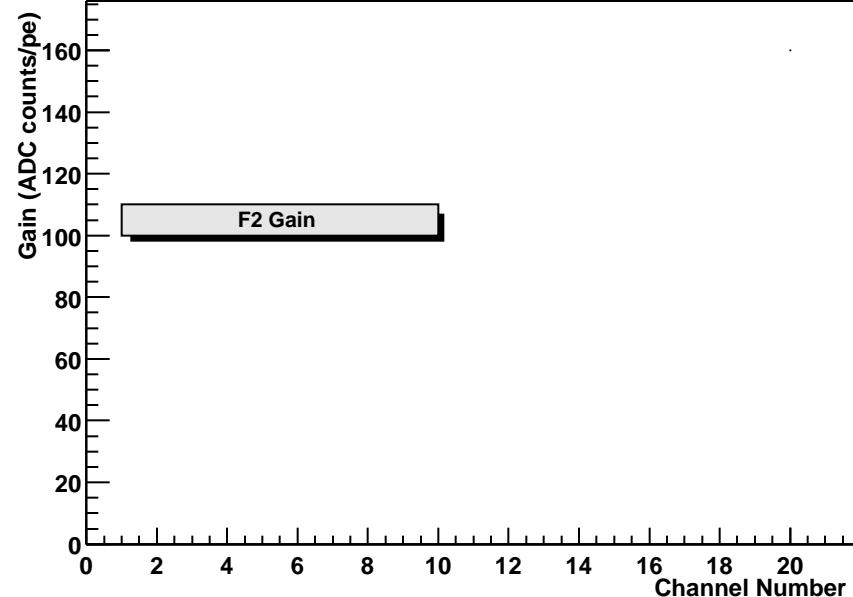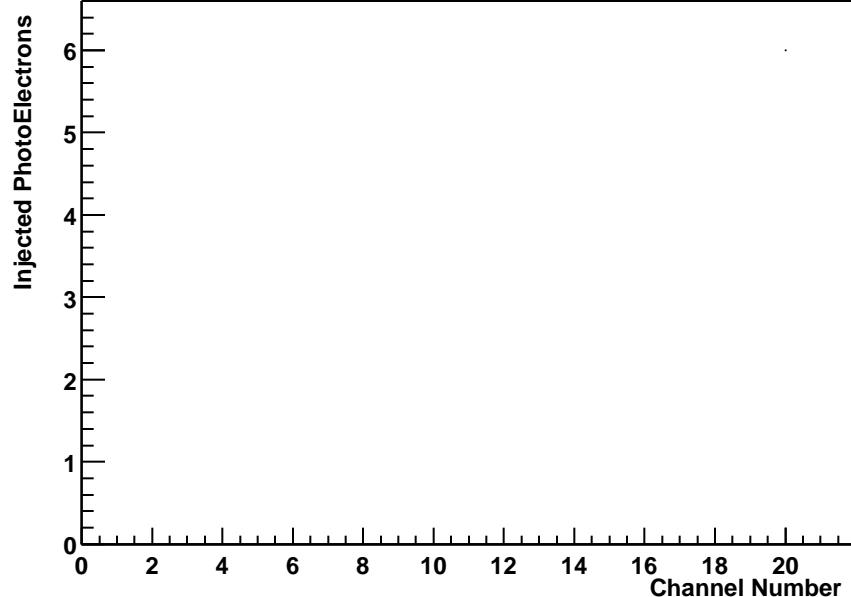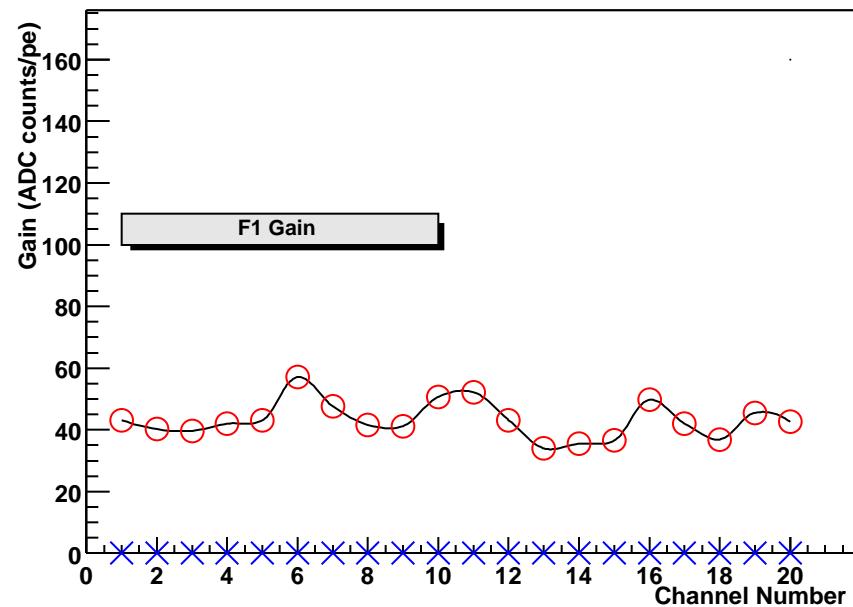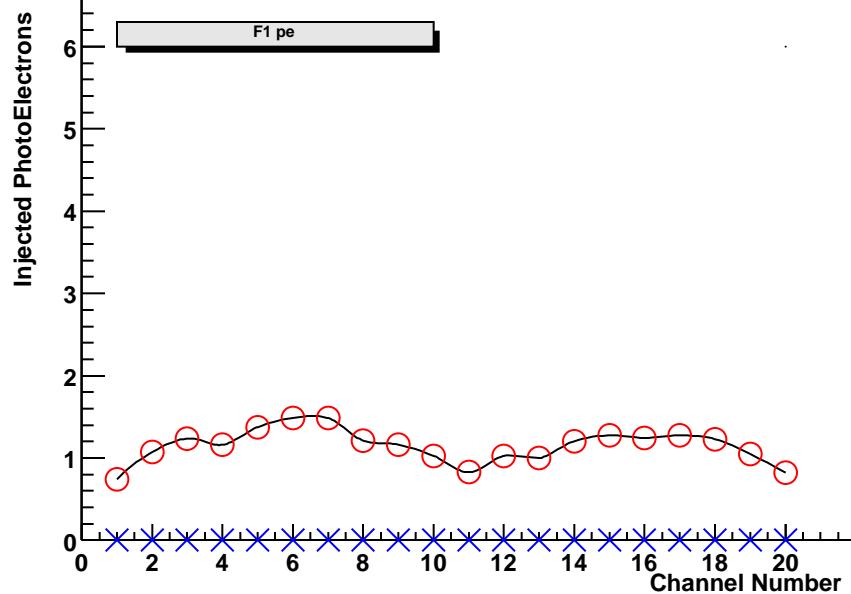

Fri Jul 26 11:47:58 2002